


PLAN

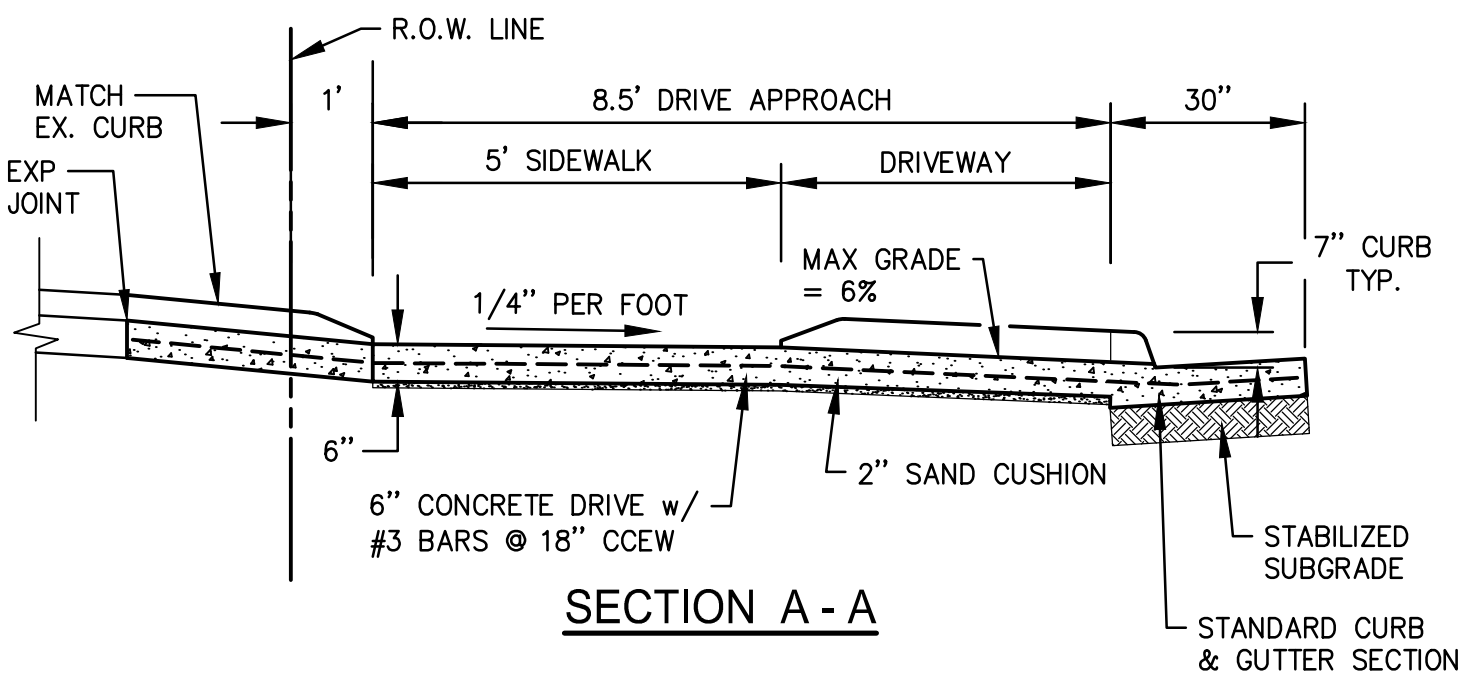

SECTION A - A


NOTES:

1. CURB & GUTTER TO BE PLACED MONOLITHICALLY WITH CONCRETE VALLEY.
2. CONCRETE SHALL BE A MINIMUM OF 6 SACK DESIGN WITH A 28 DAY COMPRESSIVE STRENGTH OF 3600 PSI.

FEBRUARY 2018

NOT TO SCALE

REVISIONS:



City of Benbrook
 911 Winscott Road
 Benbrook, Texas 76126
 817-249-3000

**COMMERCIAL
 DRIVEWAY
 SP-012**